Order number: 72130-180-01

#### General usage

The µBrick range consists of five different actuator types and distinguishes itself through its extremely small and compact construction

The device comes in a 4TE wide DIN Rail casing so it can be directly integrated into the mains distribution box and as well in flushmounted cabinets. They are perfect for mounting in cavity walls and floors with a minimum amount of effort.

In the ETS application's basic setting, the standard parameters for simple switch functions are visible. If the basic settings are changed, only those parameters are shown which are relevant to the selected function.

An overview of the functions:

- Binary inputs for the connection of:
  - Conventional motion detectors
  - Temperature sensors
  - Window contacts
  - Threshold value switches
  - Etc.
- Binary channel outputs with objects for:
  - Current status notifications
  - Operating hours (counting bi-directionally)
  - Switching cycle counters (counting bi-directionally),
  - KNX scenes, timer functions, activation objects, etc.
- Objects for sun protection screen control in connection with objects for:
  - Current status notifications, scene control, activation objects, etc.
- Advanced objects and functions such as:
  - Logic functions (Boolean, gate and filter functions, comparators), data point conversion, KNX scenes, value setting objects, analogue and digital alarms, etc.



### Order number: 72130-180-01

#### Device type and accessories

At present the following device types are available in the uBrick control group

Ref.	Description	Order number:
io66	6 Inputs (bin & analog) / 6 Resistive outputs	72130-180-01
08	8 Resistive outputs	72130-180-02
io66X	6 Inputs (bin & analog) / 4 Resistive & 2 Capacitive outputs	72130-180-03
o12X	8 Resistive & 4 Capacitive outputs	72130-180-04
018	18 Resistive outputs	72130-180-05
NTC	NTC sensor temperature, 2 m cable	72130-185-01

#### Scope of delivery

The following individual components are included in the delivery of the µBrick device:

- Complete device with connected bus connector
- 6 x 2,7kΩ end-line resistors to use for supervised/monitored inputs
- Operating and mounting instructions
- Delivered in break-proof individual packaging

#### **Application programs**

The following application programs are currently available for the uBrick io66 device:

- Actuator-io66-01-0110

For application program functions, please see the application program description.

#### Installation device

- Risk of death by electric shock
- The device is intended for interior installation in dry rooms.
- The device must only be installed and commissioned by an accredited electrical engineer.
- Please follow country-specific safety and accident prevention rules as well as all current KNX guide lines.
- Please follow country-specific rules and regulations for the planning and construction of installations, especially with regard to emergency lighting systems.
- For the installation the device must be switched to zero potential.
- Do not open the device! Faulty devices must be returned to the manufacturer.

# Order number: 72130-180-01

### **Technical data**

POWER & OUTPUTS SPECIFICATIONS			
Power supply	Via KNX bus	2130V DC	
	Max. current consumption	10,9mA	
Additional supply		No	
Number of outputs		6 outputs (binary) or 3 channels	
		(blinds)	
Type of output		Dry contact (potential-free)	
Outputs per channel		2 outputs per common/channel	
Output nominal values	AC rated current / voltage	10A / 250V AC 50/60Hz	
	DC rated current / voltage	10A / 30 V DC	
Channel (2 outputs) nominal	AC rated current / voltage	10A / 250V AC 50/60Hz	
values	DC rated current / voltage	10A / 30 V DC	
Current load rating per device		30A / 250V AC 50/60Hz	
		10A per output / 10A per common	
Phases switching distribution		Only 1 phase is allowed	
Output life expectance	Mechanical	$> 10^7$ operations (at 300 times/min)	
	Electrical	> 10 <sup>5</sup> cycles with resistive load at	
		max current (at 20 times/min)	
Connections	KNX bus connection terminal	0,8mm² solid	
	Terminal screw block	max. 3mm Ø solid	
	Tightening torque for terminal screw	maximum 0.5 Nm	


	INPUTS SPECIFICATIONS		
Number of inputs	Total inputs	6 binary/analog mixed inputs with one common terminal.	
Type of inputs	Binary Analog	<ul> <li>Ready for dry contacts</li> <li>Ready for: <ul> <li>Standard movement detector with dry contact output</li> <li>Specific movement detector with analog output (light sensor &amp; mov. detection)</li> <li>Sensor temperature NTC</li> <li>Monitorized inputs with end line resistor</li> </ul> </li> </ul>	
Scanning voltage		3,3V at common input	
Input current 0,3mA per input		0,3mA per input	
Protection Short-circuit proof		Short-circuit proof	
Max cable length		40m for binary & analog inputs	
Connections	Terminal screw block Tightening torque for terminal screw	max. 1.2mm Ø solid maximum 0.5 Nm	


## Order number: 72130-180-01

	GENERAL SPECIFICATIONS		
Control and display Programming button LED		To assign the physical address	
elements	2 x buttons for manual channels control	To switch On/Off outputs and move Up/Down channels.	
	6 x LEDs	To display actual outputs/channels status	
Mechanical data	Casing:	Plastic ABS – V0	
	Dimensions REG casing 4TE		
	Width:	28mm	
	Height:	85mm	
	Length:	65mm	
	Weight:	120gr	
	Mounting:	35mm DIN rail & flush-mounted cabinets	
Electrical safety	Degree of contamination:	2	
	Protection type (in accordance with EN60529):	IP20	
	Protection class (according to IEC 1140):	class II	
	Overvoltage category:	class III	
	KNX Bus:	Separated extra-low voltage SELV DC 24	
EMC requirements	Complies with:	EN 50491-5-2	
		EN 50491-5-3	
Environmental conditions	Clima conditions:	EN 60721-3-3 class 3k5	
	Operation temperature:	-5°C to +45°C	
	Storage temperature:	-25°C to +70°C	
	Rel. humidity (non condensing):	5 % to 93 %	
Certification		KNX registered	
CE-Signage		According to EMC-Guidelines (Residentia	
		and commercial buildings), Low Voltage	
		guidelines	

#### Location and function of the LEDs and control elements

The programming button and programming LED are required for commissioning and are only accessible in the distribution box when the cover is removed.

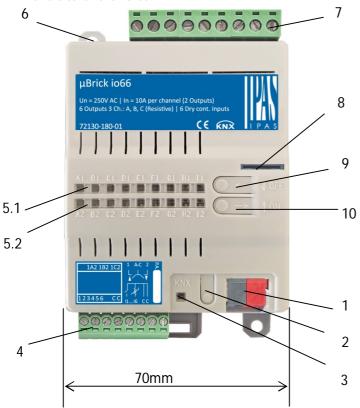

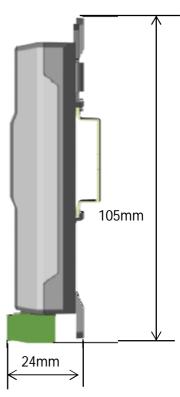

Order number: 72130-180-01

- 1: KNX bus connector
- 2: Programming button
- 3: Programming LED
- 4: Binary and analog inputs connector
- 5: LED output/channel status
- 5.1 Binary channel LED ON = Output ON, LED OFF = Output
- OFF / Shutter: Upper LED blinks while moving UP 5.2- Binary channel LED ON = Output ON, LED OFF = Output
- OFF / Shutter: Lower LED blinks while moving DOWN

- 6: Surface mount fixing holes
- 7: Outputs connector (Channels A, B,C)
- 8: SD card slot (only for internal use)

9: Upper button manual control (See Annex 1)

- Long press: Move Down (Lower LED blinks while moving) / Toggle to OFF (Selected binary channel LED fixed OFF)
- Short press: Scroll left channel/output

10: Lower button manual control (See Annex 1)

- Long press: Move UP (Upper LED blinks while moving) /Toggle to ON (Selected binary channel LED fixed ON)
- Short press: Scroll right channel/output

LEDs		PUSH BUTTONS	
A1 🕇	B1 1	C11	DOWN / OFF
A2 👢	B2 🦊	C2	TUP / ON

#### Mounting and wiring

As an REG device, the uBrick series are suitable for mounting in distribution boxes on 35 mm DIN rails and wall boxes. To mount the device, it must be angled to slide onto the DIN rail from above and then locked into place with a downward movement.

Please make sure that the security latch at the bottom side of the device snaps into place and that the device is firmly attached to the rail. To dismount the device, the security latch can be pulled downwards with a suitable tool and then the device can be removed from the rail.

After the device has been inserted, the cables for the Inputs/Outputs should be attached to the upper (Outputs) and lower (Inputs) connectors. However, please make sure that these are labeled clearly.


The power supply is connected to the bottom right-hand side connector according to the order indicated on the casing. To connect the KNX cable, a standard bus connector is plugged into the respective entry on the device. Please make sure that there is double basic insulation between the KNX installation and the power supply. To do so, please insulate the wires of the KNX cable up to the bus connector with the enclosed shrinkable tubing.

Please make sure that the cables are laid in a way that ensures sufficient distance between the inputs and outputs cables

#### **OUTPUTS / INPUTS SCHEMATIC**

Each channel can be configured to be used as 2 binary outputs or as one blind channel. Inputs can be configured to receive binary and analog signals (movement detector, temperature sensor and monitored input).

# Order number: 72130-180-01

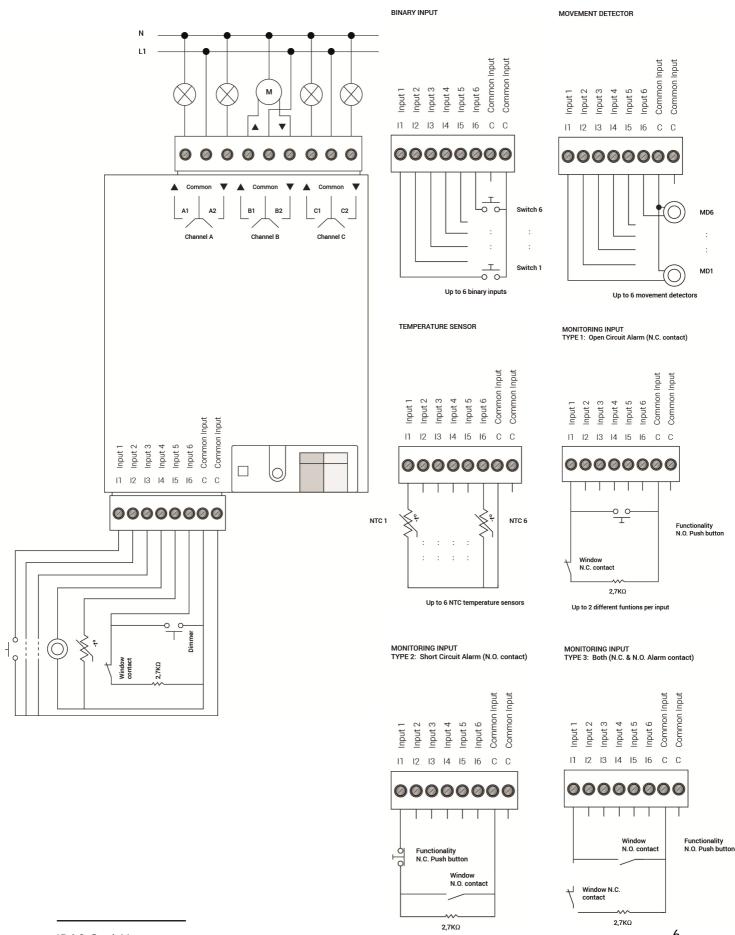

# Order number: 72130-180-01

#### **ANNEX 1: MANUAL CONTROL**

The µBrick actuator has 2 push buttons and status LEDs on the front side:

- These buttons can be activated to control each and every channel individually if you select "yes" in the relevant parameter options in Binary outputs and/or Shutter/Blinds.
- The LEDs are arranged in two rows, whereas the LEDs represent:
  - For Binary outputs:
    - The top row: channels A1, B1, C1, etc.
    - The bottom row: channels A2, B2, C2, etc.
  - o For Shutter/blinds:

.

- The top row: channel's first relay A-UP, B-UP, C-UP, etc.
  - The bottom row: channel's second relay A-DOWN, B- DOWN, C- DOWN, etc.

#### MANUAL CONTROL – PARAMETER MODE

The Parameter Mode allows you to control all the channels of the actuator as configured in the ETS.

The Action simulates a telegram received at the switching object of the selected channel.

	SHORT PRESS – Channel Selection	LONG PRESS – Action $- \downarrow^{n}$ LED blinks once off to confirm the action.	
		BINARY	SHUTTER/BLIND
TOP push button ←	<ul> <li>First press action: only indicates current channel</li> <li>Consecutive pressing actions (&lt; 0,666 sec. apart): Moves to the left</li> </ul>	Sends OFF command "0" to the "Switching" object $\downarrow$ LED = OFF (indicates channel status)	<ul> <li>First press action: Sends a DOWN command "1" to the "Move" object.</li> <li>Next press action (while shutter/blind is moving) of same button: sends a Stop command to the "Stop" object.</li> <li>LED blinks while moving DOWN during parameterized time</li> </ul>
BOTTOM push button →	<ul> <li>First press action: only indicates current channel</li> <li>Consecutive pressing actions (&lt; 0,666 sec. apart): Moves to the right</li> </ul>	Sends ON command "1" to the "Switching" object $\downarrow$ LED = ON (indicates channel status)	<ul> <li>First press action: Sends an UP command "0" to the "Move" object.</li> <li>Next press action (while shutter/blind is moving) of same button: sends a Stop command to the "Stop" object.</li> </ul>

# Order number: 72130-180-01

#### MANUAL CONTROL – TEST MODE

The Test Mode allows you to test all the loads/wiring connected to the channels. It is independent from the ETS configuration of the actuator (since the "Manual Control / Param mode + Test mode" is a default option, you can use the Test mode even before programming the actuator).

Important note: should a blind/shutter be connected to a channel, the 2 channels may never be closed at the same time. Therefore, even in Test mode, if the channel is configured as a blind, this safety measure is implemented (See XX). For this reason, it is better to first commission the OUTPUT: CHANNEL TYPE SELECTION before using the Test mode.

To change into the test mode, both of the buttons must be pressed for 2 seconds. To change back to the normal "Parameter Mode" the same procedure should be repeated. Be aware by changing back to "Parameter Mode" the device will restart. Also after the device has restarted and if the channel is configured to be a blind channel, it will do a calibration movement on the first movement command.

- In order to indicate that the actuator is in Manual Control / Test Mode, the LED of the selected channel is continuously making a short blinking action every second; no matter whether the channel is ON (LED ON) or OFF (LED OFF).

The Action switches/moves the channel, as you can see in the table below:

	SHORT PRESS – Channel Selection	LONG PRESS – Action	
	$\rightarrow \stackrel{n}{\rightarrow}$ Short LED blinking	$- \downarrow$ LED blinks once off to confirm the action.	
		BINARY	SHUTTER/BLIND
TOP push button ←	<ul> <li>First pressing: only indicates current channel</li> <li>Consecutive pressing actions (not more than 0,666 sec. apart): Moves to the left</li> </ul>	Switches OFF $\downarrow^{1}$ LED = OFF (indicates channel status)	<ul> <li>Long press: Moves DOWN</li> <li>Release: Stops</li> <li>LED blinks while moving DOWN</li> </ul>
BOTTOM push button →	<ul> <li>First pressing: only indicates current channel</li> <li>Consecutive pressing actions (not more than 0,666 sec. apart): Moves to the right</li> </ul>	Switches ON LED = ON (indicates channel status)	<ul> <li>Long press: Moves UP</li> <li>Release: Stops</li> <li>LED blinks while moving UP</li> </ul>